



Technical Report No. 64.100.17.03069.01

Rev. 00

Dated 2017-11-14

Client: Name: Guangxi Ramway Technology Co.,Ltd.
Address: No.9, Xingyu Road, High-Tech Zone 54300 Wuzhou, Guangxi PEO-
PLE'S REPUBLIC OF CHINA
contact person: Ms. Lyn Zhang

Manufacturing place: Manufacturer's name: same as client
Address: same as client
Factory's name: same as client
Address: same as client

Test subject: Product: Relays (Bistable relay)
Type: DS908A, DS908B, DS908C, DS908D, DS908E
Trade mark: Ramway

Test specification: EN 61810-1:2015,
EN 62055-31:2005 Clause 7.9 and Annex C

Purpose of examination:

- inspection according to specified requirements to realize the conformity with the Produktsicherheitsgesetz –ProdSG, version Nov 08, 2011
- inspection according to specified requirements to realize the observance of the protection aims of the following EC directives:
 - LVD directive 2014/35/EU
 - EMC directive 2014/30/EU
- Test according to the test specification

Test result: The test results show that the presented product is in compliance with the specified requirements

This technical report may only be quoted in full. Any use for advertising purposes must be granted in writing. This report is the result of a single examination of the object in question and is not generally applicable evaluation of the quality of other products in regular production.

1 Description of the test subject

1.1 Function

Manufacturer's specification for intended use:
(According to the user manual)
(Other manufacturer's sources of information)

Manufacturer's specification for predictive misuse:
(According to the user manual)
(no restrictions provided)
(e.g. combination with other products)
(If not described sufficiently, hint in point 3.2)

1.2 Consideration of the foreseeable misuse

- Not applicable
 Covered through the applied standard
 Covered by the following comment
 Covered by attached risk analysis

1.3 Technical Data

Parameter concerns (EN61810-1)	Specification
Type designation:	DS908A, DS908B, DS908C, DS908D, DS908E
Rated voltage(s) of the coil(s):	DC6V, DC9V, DC12V, DC24V
Rated power of the coil(s):	See Coil data table
Type of load:	Resistive load
Rated voltage(s) of the contacts:	250VAC
Rated current(s) of the contacts:	60A for DS908A; 90A for DS908C; 100A for DS908B, DS908D and DS908E.
Electrical endurance/number of cycles:	10 000 cycles
Mechanical endurance/number of cycles:	1 00 000 cycles
Thermal class:	B
Ambient temperature range:	-40°C to +85°C
Categories of environmental protection(RT):	RT I
Type of interruption:	<input type="checkbox"/> Micro-interruption <input checked="" type="checkbox"/> micro-disconnection <input type="checkbox"/> full-disconnection
Type of insulation between coil(s) and contacts:	<input type="checkbox"/> Functional insulation <input checked="" type="checkbox"/> basic insulation <input type="checkbox"/> reinforce insulation
Glow-wire test:	850°C
Pollution degree:	2
Rated impulse withstand voltage(s):	4kV
Operative range:	Class 1
Release voltage/or Reset voltage:	See Coil data table
Coil(s) resistance:	See Coil data table
Number of poles:	2
Circuit diagram:	c
Kind of contacts:	Make contacts
Material of contact:	AgSnO ₂




Parameter concerns (EN61810-1)	Specification
Electrical endurance/frequency of cycles:	720/h
Duty factor:	25% (1.25s on, 3.75s off)
Kind of terminals:	Welding terminals
Overtoltage category:	II
Rated insulation voltage(s):	250VAC
Insulation material group:	IIIa
Tracking resistance/PTI:	175V
Mechanical endurance/frequency of cycles:	1800/h
Resistance to soldering heat:	N/A
Mounting position:	Any
Mounting distance:	50mm
Test procedure:	Group mounting
Parameter concerns (EN 62055-31)	Specification
Minimum switched current:	1.0A
Rated breaking current (Ic):	60A for DS908A; 90A for DS908C; 100A for DS908B, DS908D and DS908E.
Rated breaking voltage (Uc):	250VAC
Utilisation category:	UC3

Remark: For standard EN62055-31 only clause 7.9 and annex C are considered.

Coil data table

Type of relay	Rated voltage(s) of the coil (VDC)	Coil resistance $\pm 10\%$ (Ω)		Operate/ release voltage (VDC)	Rated power of the coil (W)
		Single winding	Double windings		
DS908A	6	16	2x8	4.2	2.25
	9	36	2x18	6.3	2.5
	12	54	2x27	8.4	2.6
	24	200	2x100	16.8	2.9
DS908B	6	12	2x6	4.2	3.0
	9	18	2x9	6.3	4.5
	12	32	2x16	8.4	4.5
	24	128	2x64	16.8	4.5
DS908C	6	16	2x8	4.2	2.3
	9	36	2x18	6.3	2.3
	12	54	2x27	8.4	2.7
	24	200	2x100	16.8	2.9
DS908D/ DS908E	6	17	2x9	4.2	2.1
	9	20	2x10	6.3	4.1
	12	34	2x17	8.4	4.2
	24	135	2x68	16.8	4.3

Coil connection diagram

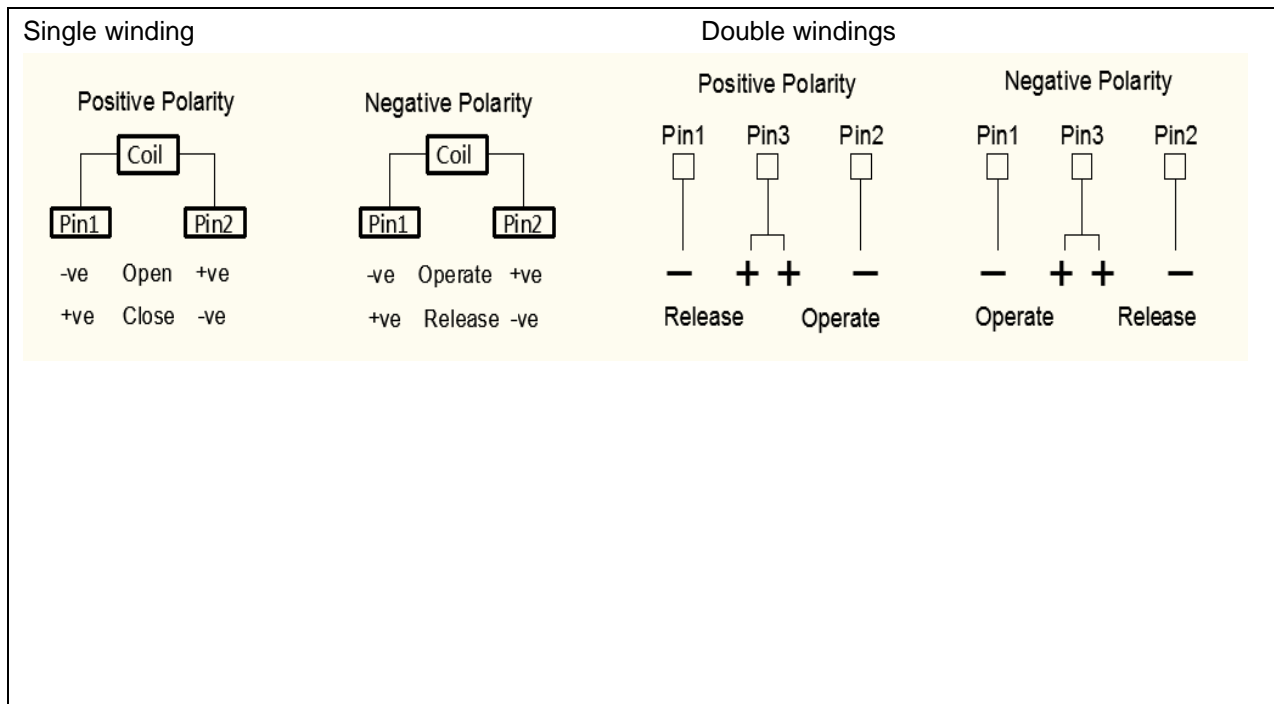

2 Order

2.1 Date of Purchase Order, Customer's Reference

2017-05-03

2.2 Receipt of Test Sample, Location

2017-08-08, TÜV SÜD Certification and Testing (China) Co., Ltd. Guangzhou Branch

2.3 Date of Testing

2017-08-08 to 2017-11-10

2.4 Location of Testing

Zhejiang Fang Yuan Electric Equipment Test Co., Ltd.
NO. 400 Guangqiong Road, JiaXing City, Zhejiang Province, China

2.5 Points of Non-compliance or Exceptions of the Test Procedure

None.

3 Test Results

3.1 Positive Test Results

- Electrical safety (Report No.: 64.100.17.03069.01 Dated: 2017-11-14)

3.2 Points of non-compliance according to the test specification



None.

4 Remark

4.1

Your production facility is currently on a
 Annual (12 month) inspection cycle,
 Bi-Annual (6 month) inspection cycle,
 Quarterly (3 month) inspection cycle.

Final inspection requirements for production are described in: EN 61810-1:2015. Routine tests are given in table 4 including Marking and documentation, Basic operating function and Dielectric strength.

4.2 The user manual has been examined according to the minimum requirements described in the product standard. The manufacturer is responsible for the accuracy of further particulars as well as of the composition and layout.

4.3 When the product is placed on the market, it must be accompanied with safety instructions written in official language of the country. The instructions shall give information regarding safe operation, installation and maintenance.

5 Documentation

- CDF
- Photo documentation

6 Summary

The test specifications are met.

TÜV SÜD Certification and Testing (China) Co., Ltd. Guangzhou Branch
TÜV SÜD Group

Engineer:

Anna Wang

Anna Wang
Project Handler

Technical Report checked:

Martin Ma

Martin Ma
Designated Reviewer

--- End of Report ---